



*Manufacturers of Process
Controls and Instrumentation*

Instruction Manual

Model: *ITC-XX-120*

Function: *Isolator*

Input: ☐ X=1: 1-5 mA ☐ X=4: 10-50 mA
☐ X=2: 4-20 mA ☐ X=5: 1-5 VDC
☐ X=3: 0-1 mA ☐ X=6: 0-10 VDC
☐ X=7: _____

Output: ☐ X=1: 1-5 mA ☐ X=4: 10-50 mA
☐ X=2: 4-20 mA ☐ X=5: 1-5 VDC
☐ X=3: 0-1 mA ☐ X=6: 0-10 VDC
☐ X=7: _____

Power: ■ 120 VAC, 80 mA

Serial #: _____
(If special or required)

For Technical Assistance And Questions Call
USA: (231) 788-2900 CANADA: (905) 660-5336

Restocking Policy

All product returned to Pribusin Inc. in prime condition (not damaged, scratched or defaced in any way) within seven (7) months from the original date of shipment is subject to a 50% restocking charge. All product must be accompanied by a Return Authorization number (RA number) which must be obtained from Pribusin Inc. prior to returning any product.


After seven (7) months from the original date of shipment, products cannot be returned for restocking.

Custom designed products, modified products or all non-standard products may not be returned for restocking.

Warranty Policy

Pribusin Inc. warrants equipment of its own manufacture to be free from defects in material and workmanship, under normal conditions of use and service, and will replace any component found to be defective, on its return to Pribusin Inc., transportation charges prepaid, within one year of its original purchase. Pribusin Inc. will extend the same warranty protection on equipment, peripherals and accessories which is extended to Pribusin Inc. by the original manufacturer. Pribusin Inc. also assumes noliability, expressed or implied, beyond its obligation to prelace any component involved. Such warranty is in lieu of all other warranties, expressed or implied.

Isolated Terminal Signal Conditioner

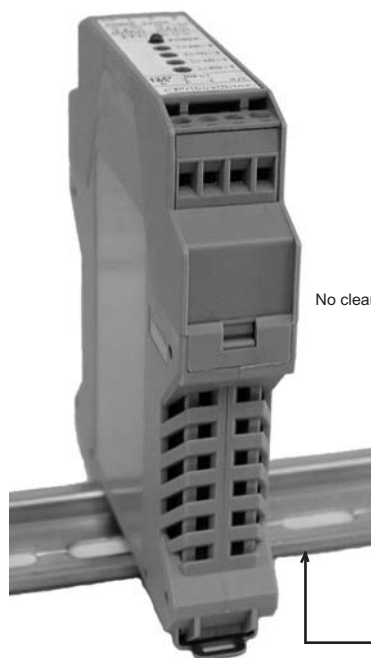

No cleaning must be provided

Din-rail mounting (width 22.5 mm.)

Standard Features:

High Input-Output-Power Isolation
(2000 VAC Test for 1 second)

Low Input Impedance on 4-20mA Inputs

Small Size - Fits on Terminal Block Rail

Industry Standard Inputs and Outputs (see back)

High Output Drive (1000 Ohms for 4-20 mA)

Two Wire Supply Option for Two Wire Transmitters

Power: 120 VAC, 50/60 Hz , 80 mA

High Noise Rejection

CSA Certification 2054910



Pollution Degree 2

Installation Category II

Do Not Expose To Direct Sunlight

The ITC-XX is a signal isolator that provides high isolation from Input to Output to Power in a small, easy to install package. The universal DIN rail mount often makes it possible to install the ITC-XX right next to the instrument that is to be isolated. The many different input and output configurations allow it to be used in a great variety of applications ranging from PLC front end conditioning.

The high output drive (1000 Ohms @ 4-20 mA) allows the ITC-XX to drive several other instruments directly from its output. The standard two wire supply allows the ITC-XX to be used with two wire field transmitters such as differential pressure transducers and temperature sensors, etc.

If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired

Specifications:

Specifications:


	ITC-XX	ITC-SLXX	ITC-MVXX	ITC-TXXX
Power 120 VAC	80mA	80mA	80mA	80mA
Isolation	High Input to Output to Power (2000 VAC Test for 1 second)			
Input Impedance	see Input table	10 Meg Ohm	10 Meg Ohm	10 Meg Ohm
Accuracy / Linearity	+/-0.2% max., +/- 0.1% typ.	+/-0.2% max., +/- 0.1% typ.	+/-0.3% max., Drift 1µV/°C	Linear with Material ± 2°C
Loop Res. D Effect	-0.1% per 100 Ohms change			
Common Mode Rej.	at 60 Hz = 120 dB			
Response Time	50 msec to 63%	75 msec to 63%	100 msec to 63%	100 msec to 63%
Drift at 25 Deg.C	24 Hours: ± 0.03%, 30 Days: ± 0.1%		24 Hours: ± 0.3%, 30 Days: ± 0.8%	
Operating Temp.	-40 Deg. C. to + 50 Deg. C.			
Environment	Altitude: 0-6562 ft (0-2000 m) Humidity: 0-95% RH non-condensing			

(Maximum Signal Input 30VAC or 60VDC or 5Amps)


(Maximum Signal Output 30VDC or 50mA)

ITC-XX-120

Connection:

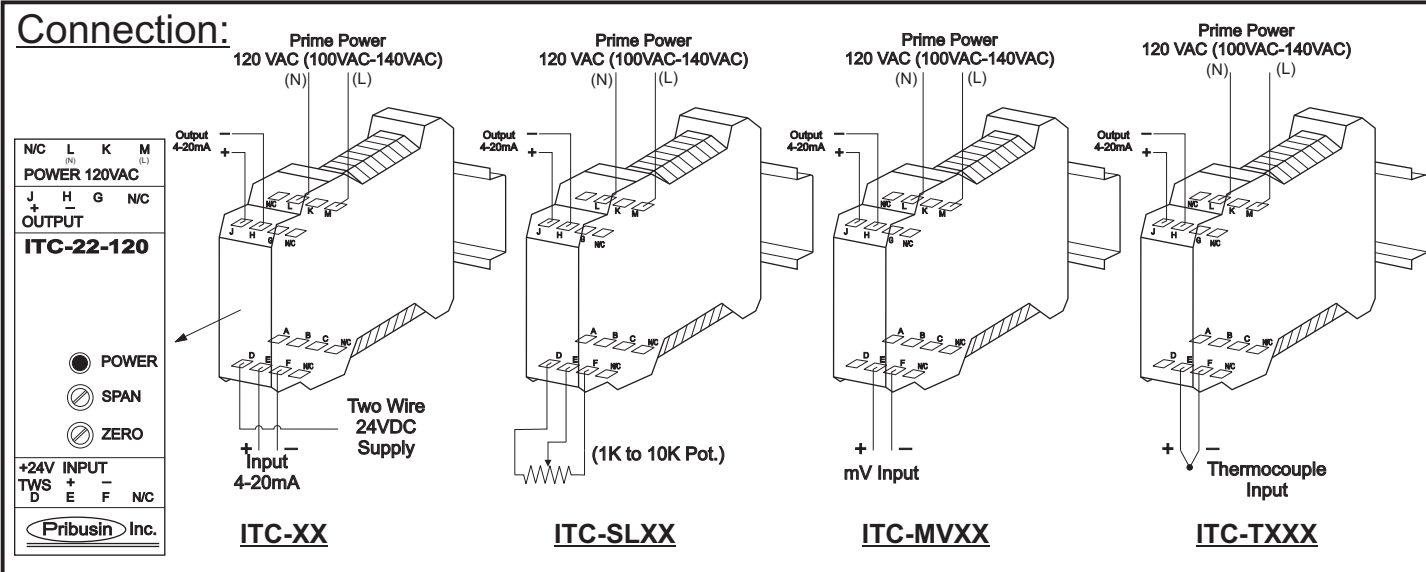


Model Designation:

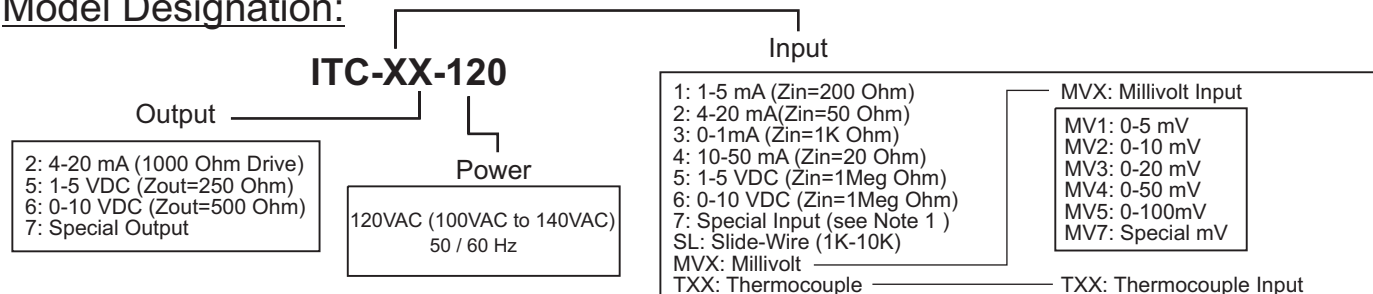

Model Designation Examples:

1. Isolator with 4-20mA input, 4-20mA output, powered by 120VAC is: **ITC-22-120**
2. Isolator with 0-50mV input, 0-10VDC outputs powered by 120VAC is: **ITC-MV46-120**
3. Isolator with type 'K' thermocouple input for 0-750°F and 4-20mA output, powered by 120VAC is: **ITC-TK32-120**

Dimensions:

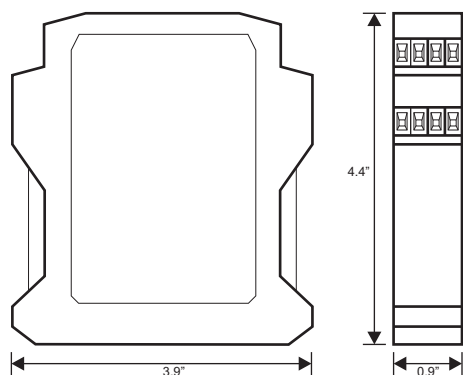

Range	Type	J	K	E	T	R	S
0 to 300F -18 to 150C	TJ1			TE1	TT1		
0 to 400F -18 to 204C	TJ2	TK1		TE2	TT2		
0 to 500F -18 to 260C	TJ3	TK2		TE3	TT3		
0 to 750F -18 to 400C	TJ4	TK3		TE4		TR1	TS1
0 to 1000F -18 to 538C	TJ5	TK4				TR2	TS2
0 to 1500F -18 to 816C		TK5				TR3	TS3
0 to 2000F -18 to 1093C		TK6				TR4	TS4
0 to 3200F -18 to 1760C						TR5	TS5
-350 to 1100F -200 to 600C	TJ6			TE5			

(Note 1. Maximum Signal Input 30VAC or 60VDC or 5Amps)

Manufactured By:

Pribusin Inc.

www.pribusin.com
info@pribusin.com

USA:


Pribusin Inc.
743 Marquette Ave.
Muskegon, MI 49442
Ph: (231) 788-2900
Fx: (231) 788-2929





CANADA:

Pribusin Inc.
101 Freshway Dr. Unit 57
Concord, Ontario, L4K 1R9
Ph: (905) 660-5336
Fx: (905) 660-4068

NORMAL CONNECTION

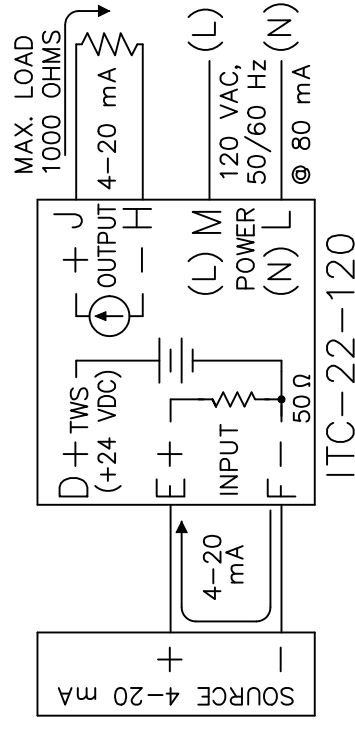

TWO WIRE INPUT CONNECTION

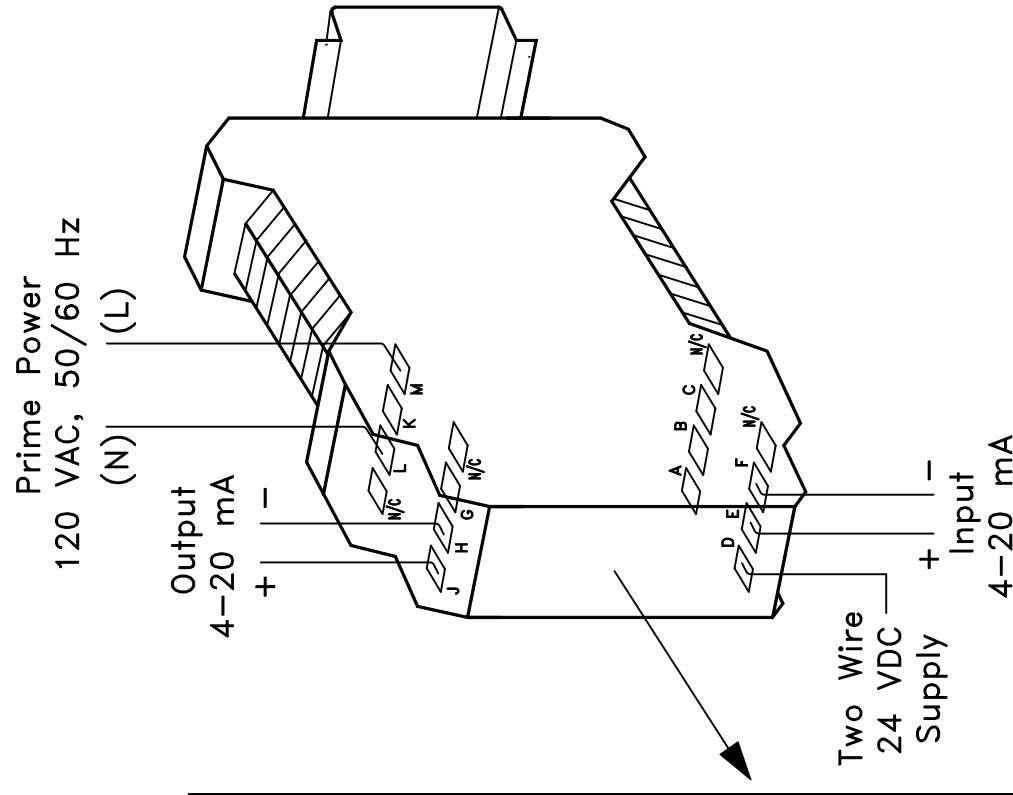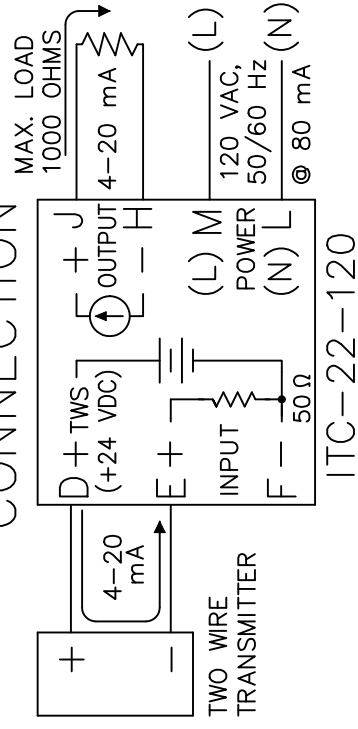



N/C	L (N)	K	M (L)
POWER 120VAC			
J +	H —	G	N/C
OUTPUT			
Pribusin Inc.			
ITC-22-120			
		 POWER	
		 SPAN	
		 ZERO	
+24V TWS	INPUT +	—	N/C
D	E	F	

Calibration Procedure:

1. Apply an input of 4 mA to the input terminals.
2. Adjust ZERO pot. until output signal is 4 mA.
3. Apply an input of 20 mA to the input terminals.
4. Adjust SPAN pot. until output signal is 20 mA.
5. Repeat procedure starting at 1. until output signal is correct.
6. Apply an input of 12 mA to the input terminals, and check that the output is 12 mA.
7. Calibration is complete.



Notes:

1. For Enclosure Details
See Dwg. 106870-1.

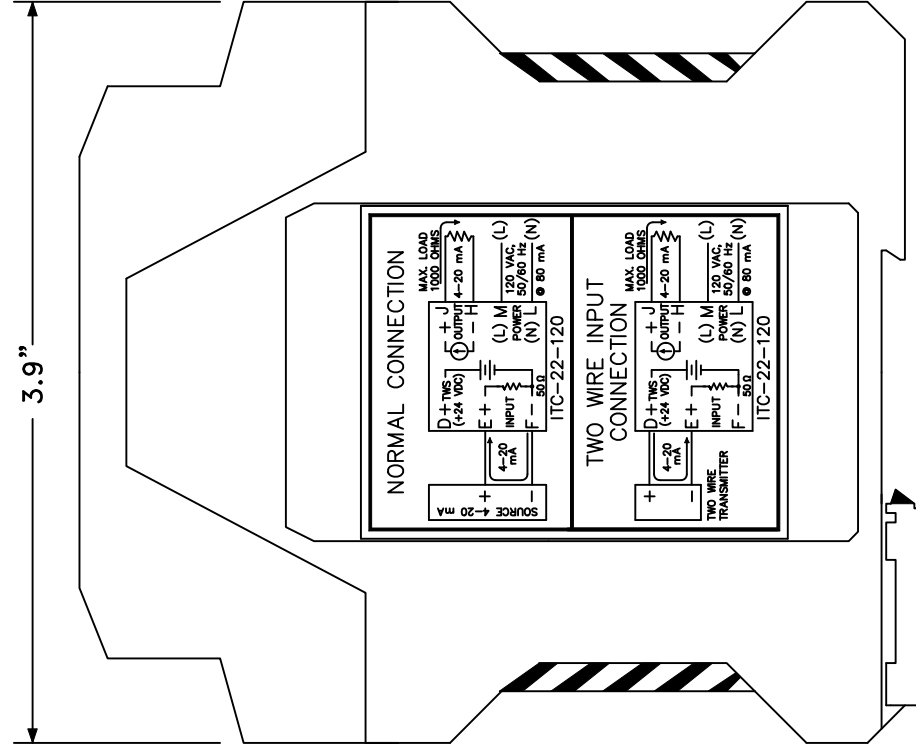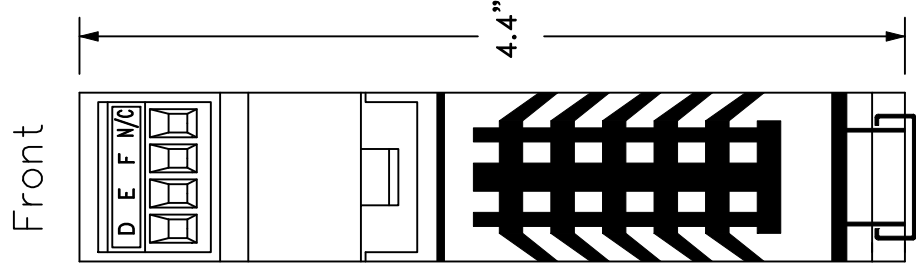

DIN-Rail Release

Top View

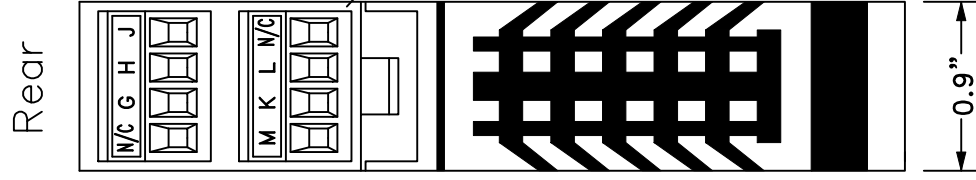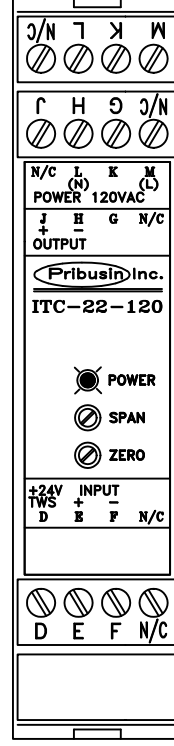

Pribusin Inc. ©

CHKD: DATE: Sept. 29/04 DRN: KS


Model: ITC-22-120
Isolated Terminal Signal Conditioner
Enclosure(/w Screw Plug Connectors)

DWG. NO.: 106870-1 REV. A

Notes:

1. For Connections/Calibration Details See Dwg. 106869-1.

Enclosure Detail :

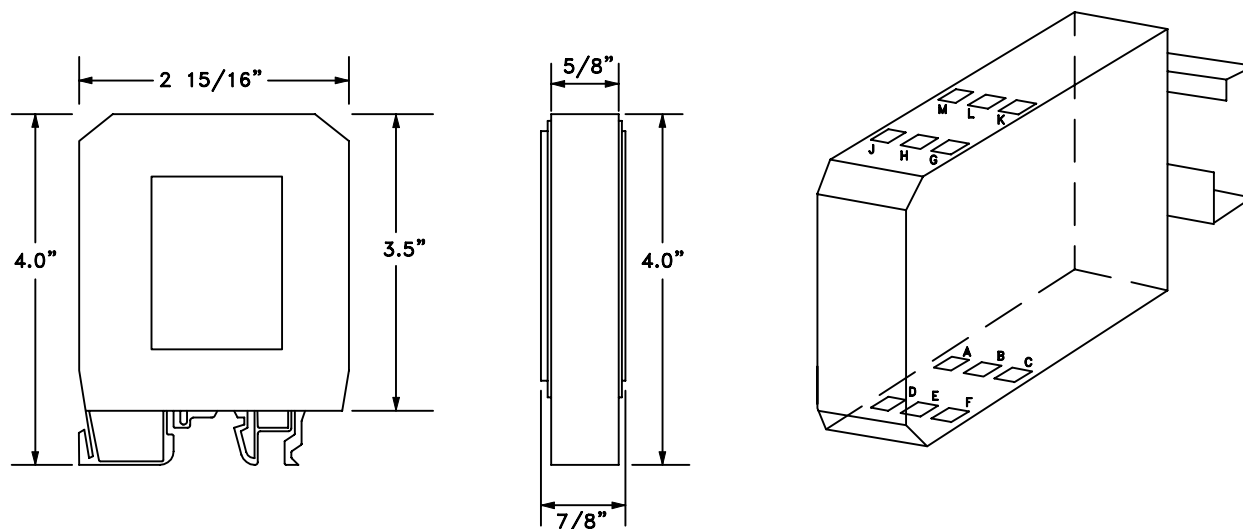

Din Rail Detail :

	A Rail Standard EN 50 035 Dimensions: 32 x 15 x 1.5 mm
	B Rail Standard DIN EN 50 022 Dimensions: 35 x 15 x 2.3 mm
	C Rail Standard DIN EN 50 022 Dimensions: 35 x 7.5 x 1 mm
	D Rail Standard DIN EN 50 022 Dimensions: 35 x 15 x 1.5 mm

Pribusin Inc. ©

CHKD: DATE: APR. 26/93 DRN: KS

Terminal Block Enclosure/
Din Rail Detail

DWG. NO. : 104384 REV. A